






NOTE:
 - INDIVIDUAL WIRING RUNS FROM THE MCP TO EACH BANNER MACHINE ARE REQUIRED.
 - MOTOR POWER WIRING FROM SEVERAL MACHINES MAY SHARE THE SAME CONDUIT AT THE DISCRETION OF THE INSTALLING ELECTRICIAN. CONDUIT FILL AND DERATING OF WIRE PER NEC MUST BE RESPECTED.
 - CONDUIT FILL PER NEC MUST NE RESPECTED.

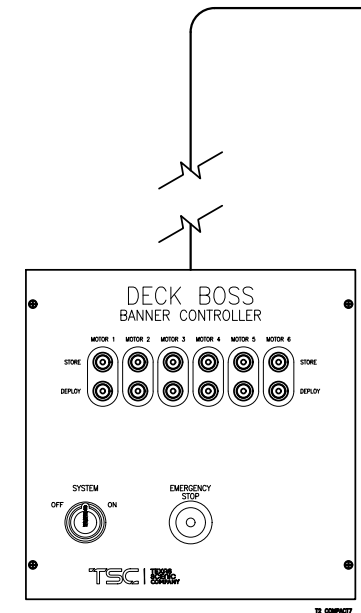

INDIVIDUAL UNIT CONTROL

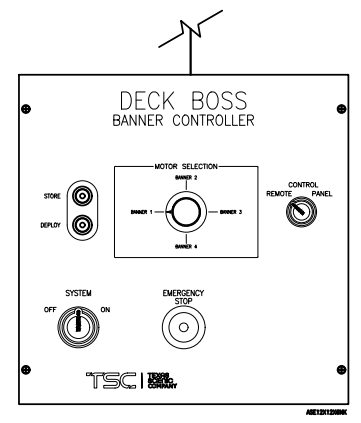

SELECTOR STYLE CONTROL
CAN BE GROUP AND/OR INDIVIDUAL

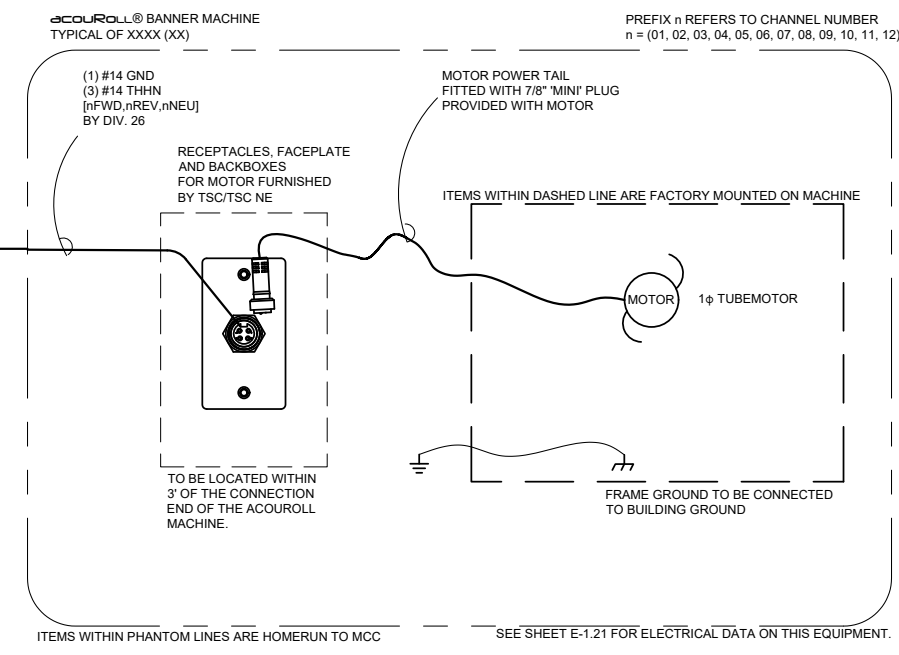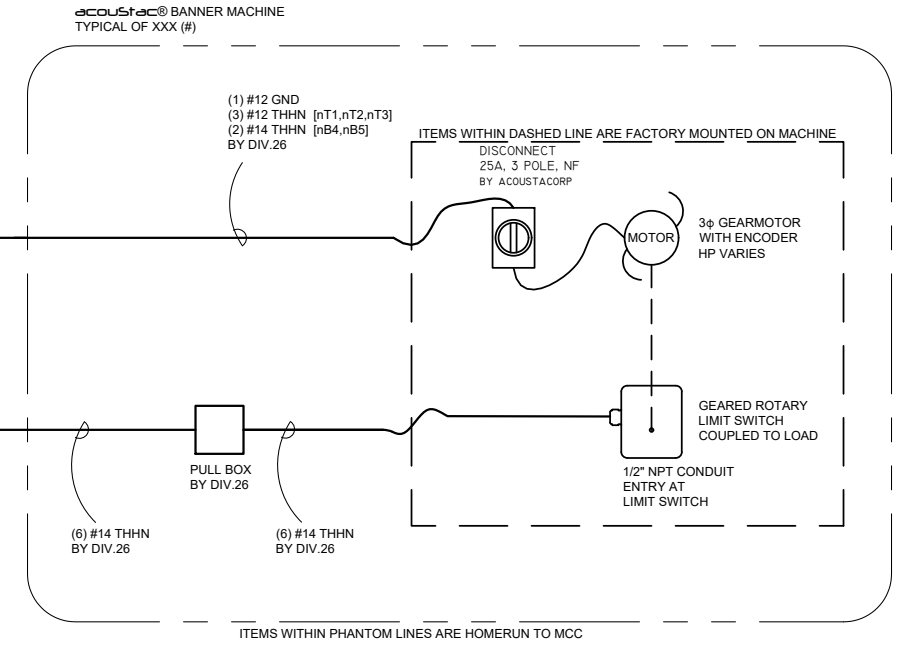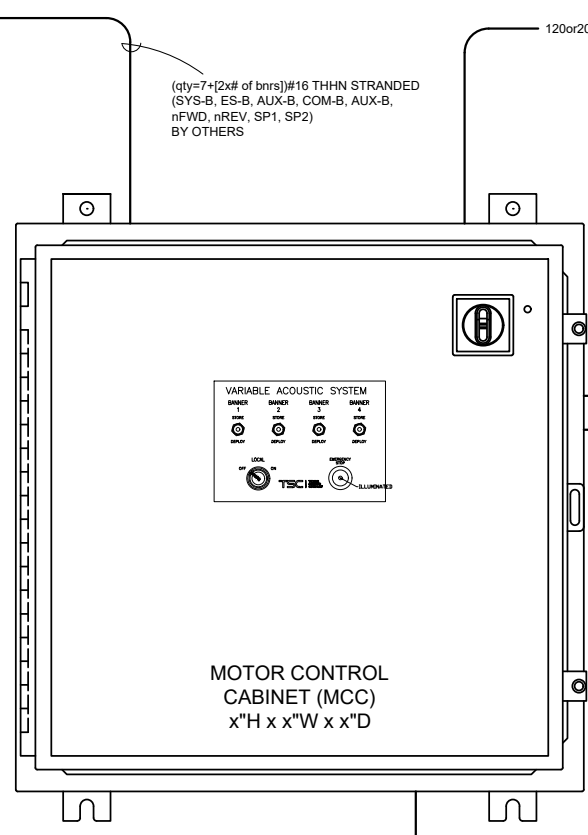

REV.	DATE:	BY:	DESCRIPTION:
A	3/12/2025	WJC	LOGO AND OPTIONS

8053 POTRANCO ROAD
SAN ANTONIO, TEXAS 78251
210-684-0091
210-684-4557 FAX

THIS DOCUMENT IS THE PROPERTY OF TEXAS SCENIC COMPANY, INC. TITLE TO THIS DOCUMENT AND ALL RIGHTS HEREIN ARE RESERVED AND WILL REMAIN THE PROPERTY OF TEXAS SCENIC COMPANY, INC. IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF TEXAS SCENIC COMPANY, INC. THE DESIGN IS CONTAINED HEREIN AND IS SUBJECT TO THE FOREGOING.

TSC TEXAS SCENIC COMPANY	ARCHITECT: -	JOB NUMBER: XX-XXXXXX
	CONSULTANT: -	DATE: 3/12/2025
CONTRACTOR: -	CHECK BY: WJC	
DRAWN BY: WJC		

PROJECT:	ACOUTUNE CONTROL SYSTEM SAMPLE
DWG. TITLE:	ADJUSTABLE ACOUSTIC CONTROL ONE LINE RISER
REV:	A
SCALE:	AS NOTED
DRAWING NUMBER:	E-1.11