NOTE:

- INDIVIDUAL WIRING RUNS FROM THE MCP TO EACH BANNER MACHINE ARE REQUIRED FOR BOTH MOTOR POWER AND ENCODER SIGNAL.
- MOTOR POWER WIRING FROM SEVERAL MACHINES MAY SHARE THE SAME CONDUIT AT THE DISCRETION OF THE INSTALLING ELECTRICIAN. CONDUIT FILL AND DERATING OF WIRE PER NEC MUST BE RESPECTED.
- THE ENCODER WIRING OF SEVERAL MACHINES MAY SHARE CONDUITS. HOWEVER, MOTOR AND ENCODER WIRING MUST BE NOT BE COMBINED IN THE SAME CONDUIT.
  CONDUIT FILL PER NEC MUST BE RESPECTED.

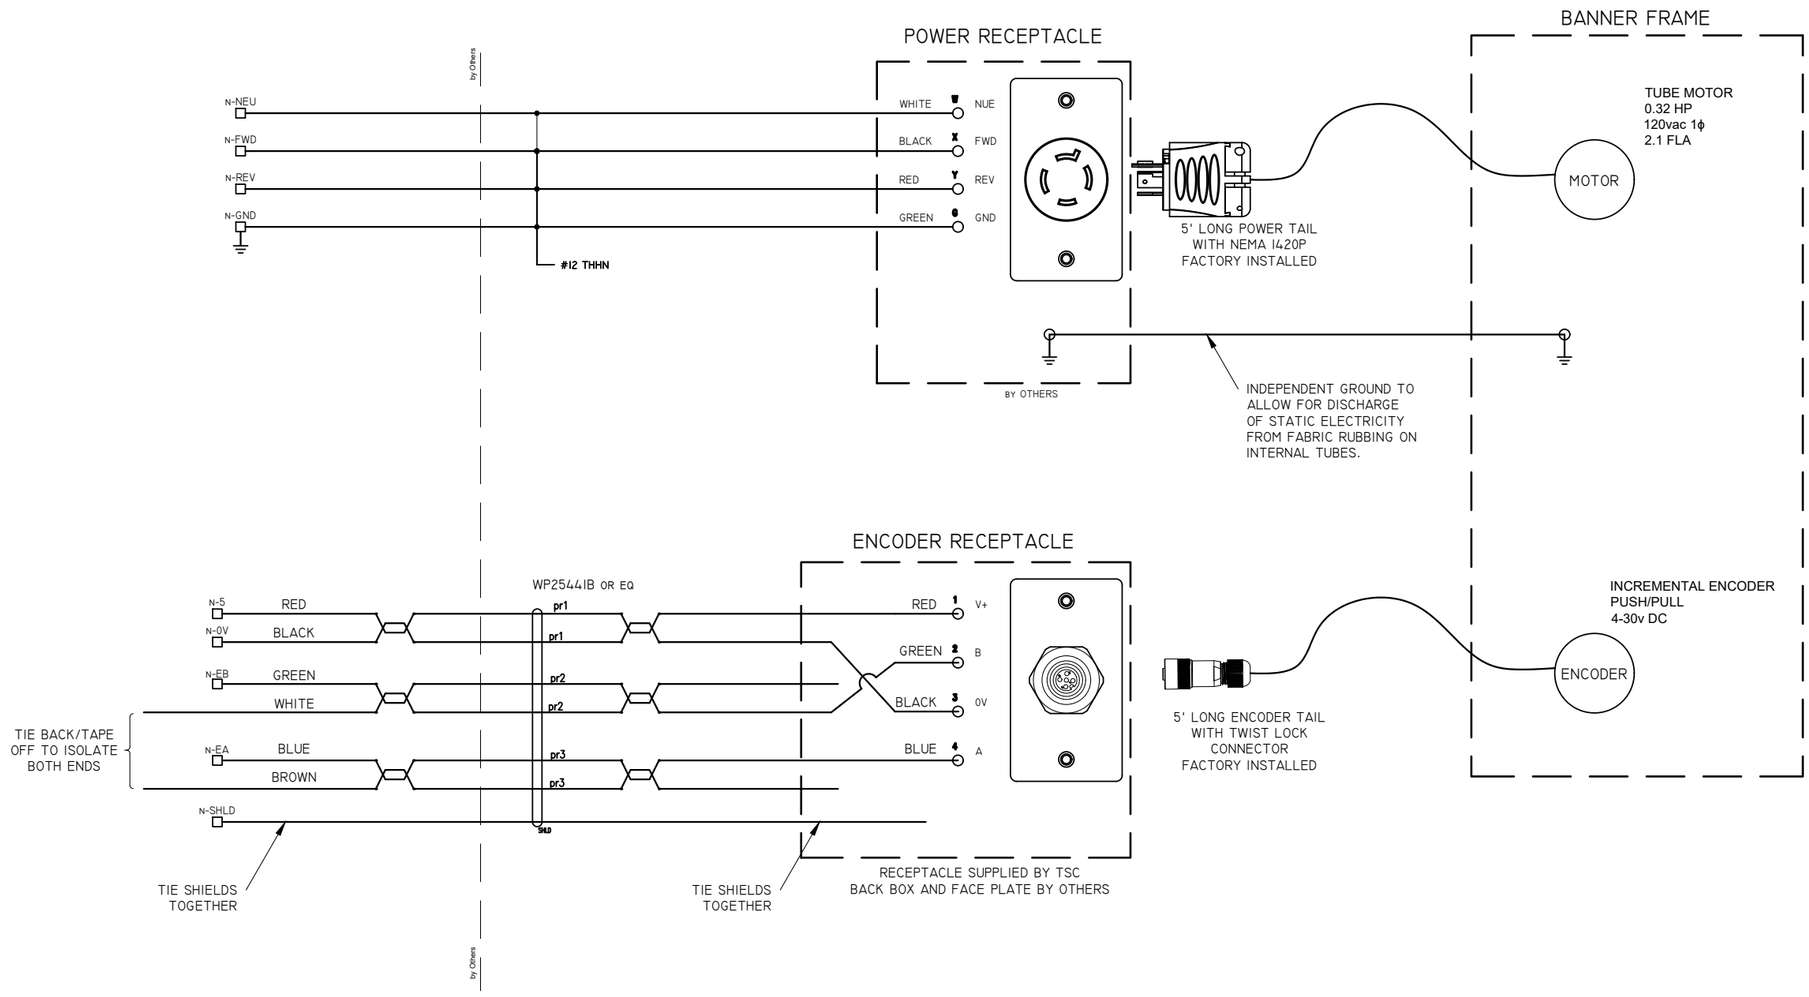

REV:	DATE:	BY:	DESCRIPTION:

8053 POTRANCO ROAD
SAN ANTONIO, TEXAS 78251
210-684-0091
210-684-4557 FAX

THIS DOCUMENT IS THE PROPERTY OF TEXAS SCENIC COMPANY, INC. THE INFORMATION ON THIS DOCUMENT IS NOT TO BE SOLD OR TRANSFERRED. TEXAS SCENIC COMPANY, INC. RESERVES ALL RIGHTS AND PROTECTIONS UNDER COPYRIGHT LAWS. ANY UNAUTHORIZED USE AND/OR ALTERATION OF THIS DRAWING OR THE INFORMATION CONTAINED HEREIN, IN THE POSSESSION OF THE DOCUMENT IS ACCEPTED SUBJECT TO THE FOREGOING.

TEXAS SCENIC COMPANY

ARCHITECT:
CONSULTANT:
CONTRACTOR:

DRAWN BY:	CHECK BY:	DATE:	JOB NUMBER:
WJC	ND	7/26/2024	

PROJECT: ACOUTUNE CONTROL SYSTEM SAMPLES

DWG. TITLE: ACOUROLL FIELD/MACHINE TERM

REV: -

SCALE: AS NOTED

DRAWING NUMBER: E100-41