


NOTE:

- INDIVIDUAL WIRING RUNS FROM THE MCP TO EACH BANNER MACHINE ARE REQUIRED FOR BOTH MOTOR POWER AND ENCODER SIGNAL.
- MOTOR POWER WIRING FROM SEVERAL MACHINES MAY SHARE THE SAME CONDUIT AT THE DISCRETION OF THE INSTALLING ELECTRICIAN. CONDUIT FILL AND DERATING OF WIRE PER NEC MUST BE RESPECTED.
- THE ENCODER WIRING OF SEVERAL MACHINES MAY SHARE CONDUITS. HOWEVER, MOTOR AND ENCODER WIRING MUST NOT BE COMBINED IN THE SAME CONDUIT. CONDUIT FILL PER NEC MUST BE RESPECTED.

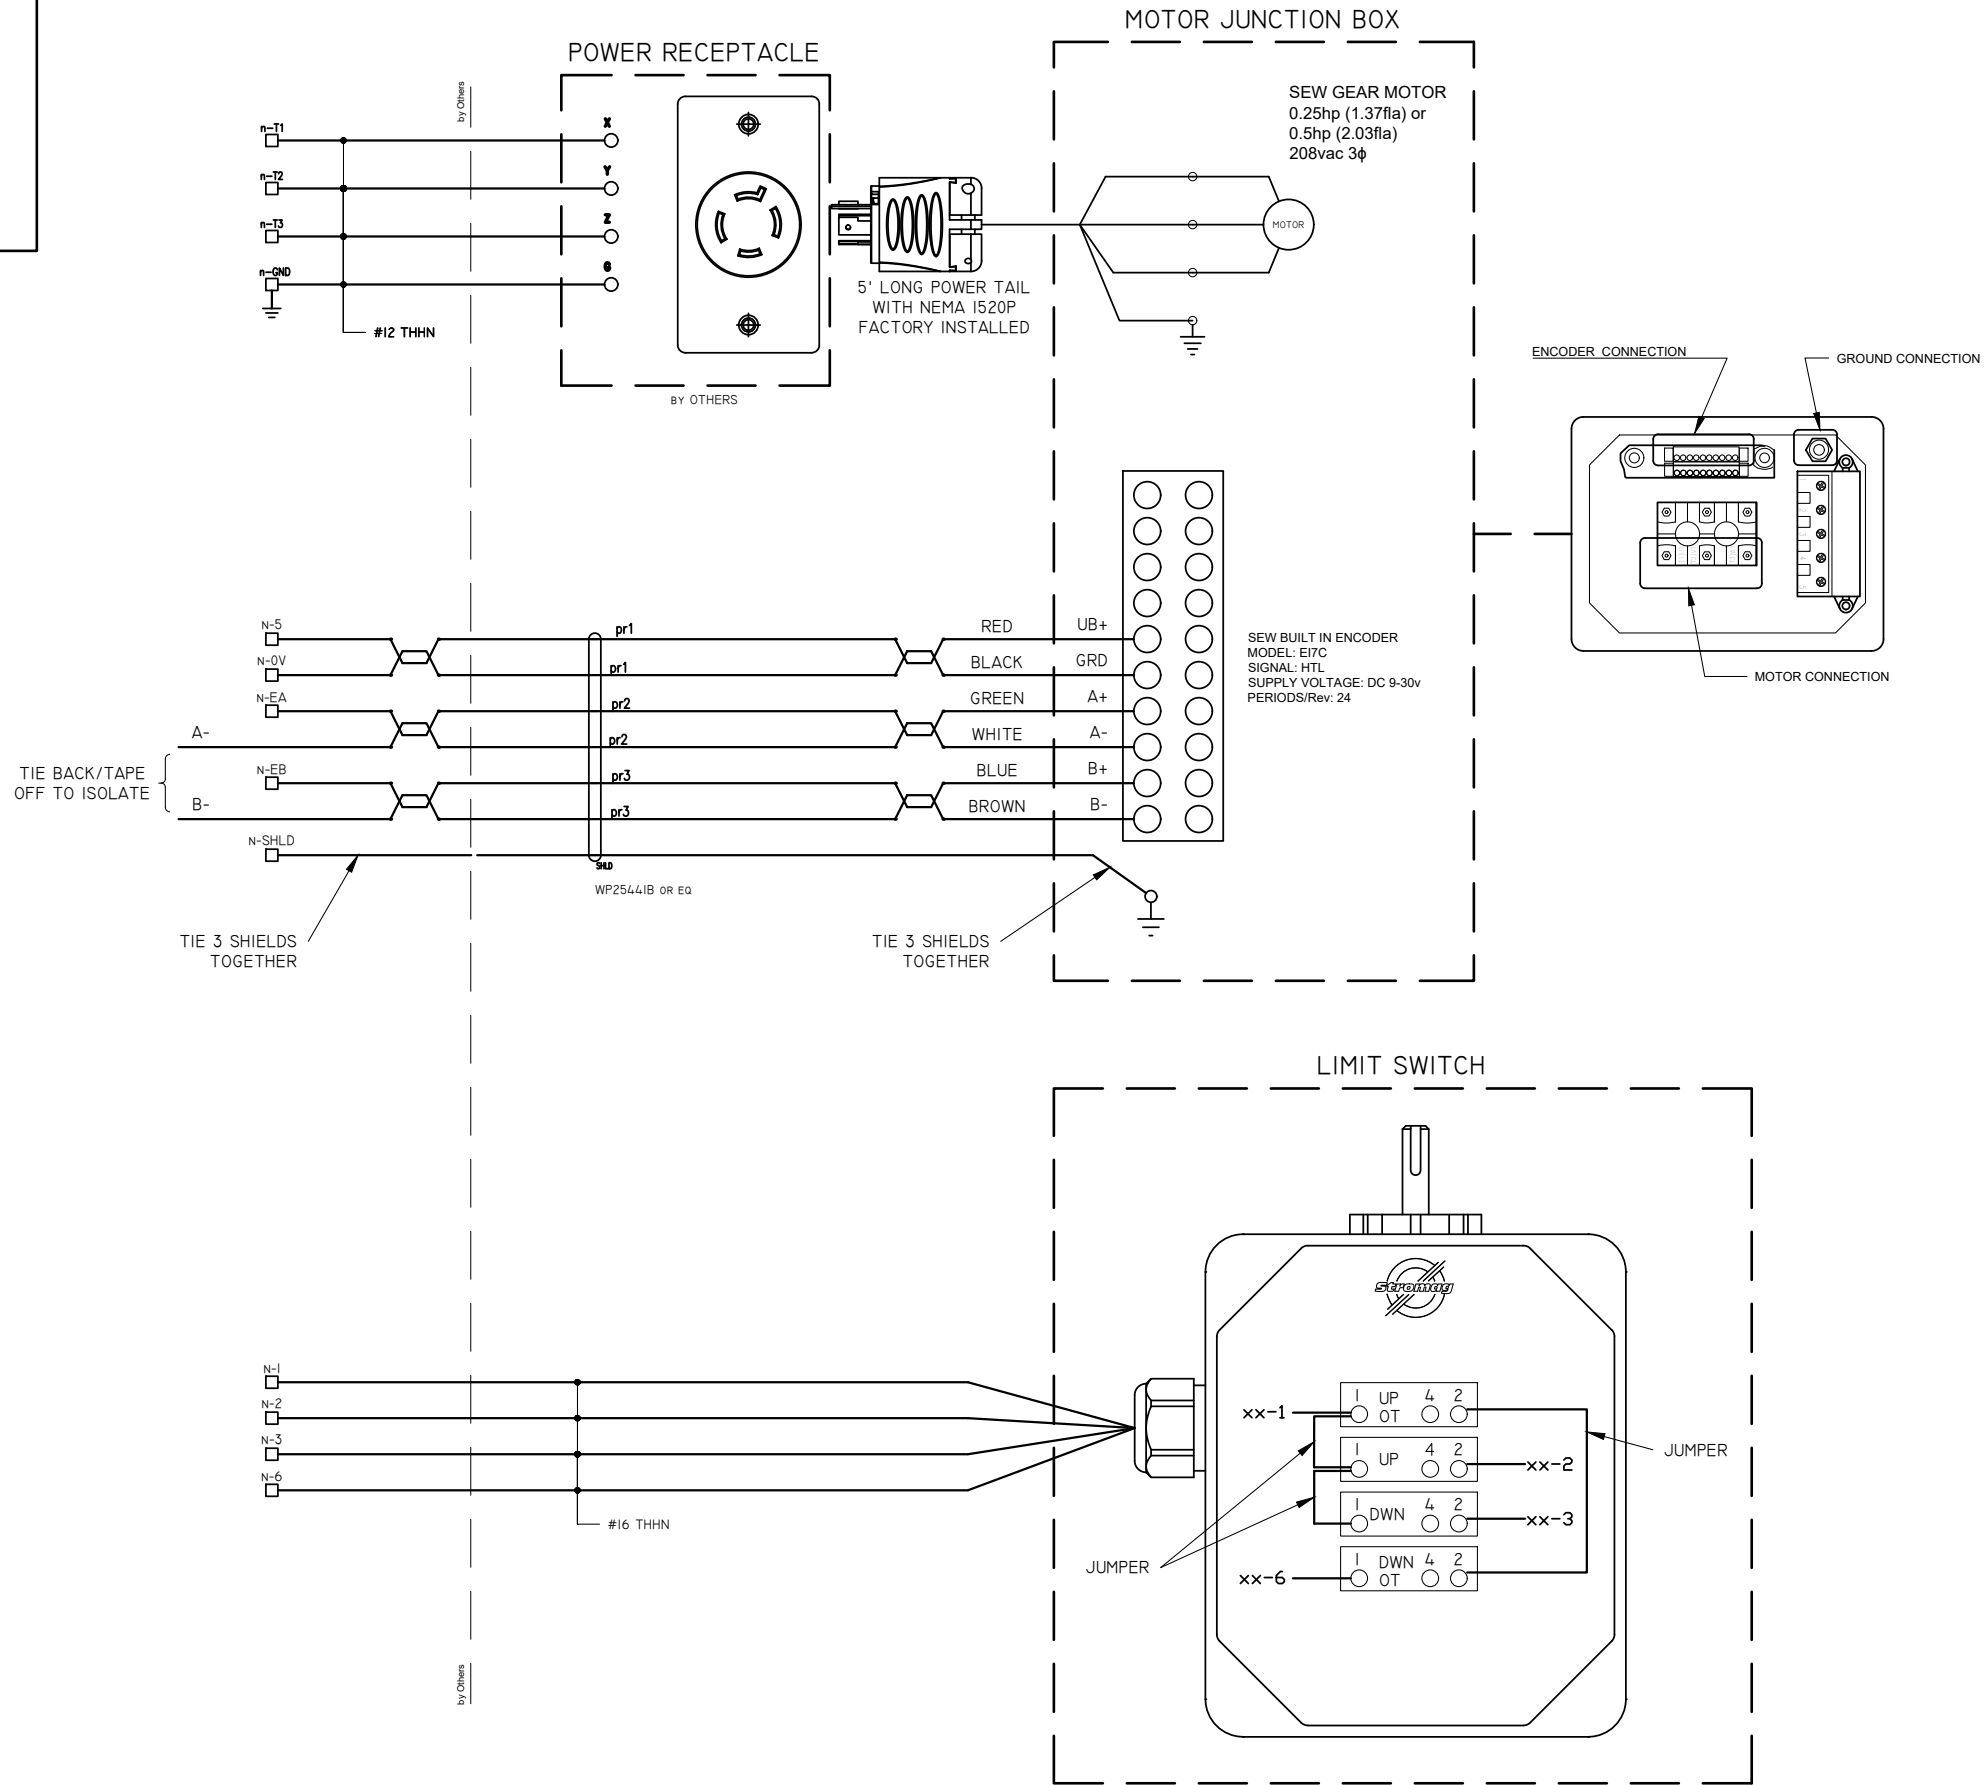

PROJECT:		ACOUTUNE CONTROL SYSTEM SAMPLES	
DWG. TITLE:		ACOUSTAC FIELD/MACHINE TERM	
ARCHITECT:	CONSULTANT:	CONTRACTOR:	WJC
DRAWN BY:	CHECK BY:	DATE:	7/26/2024
ND	ND	ND	ND
JOB NUMBER:			
8053 POTRANCO ROAD SAN ANTONIO, TEXAS 78251 210-684-0091 210-684-4557 FAX		THIS DOCUMENT IS THE PROPERTY OF TEXAS SCENIC COMPANY, INC. TITLE TO THIS DOCUMENT REMAINS WITH TEXAS SCENIC COMPANY, INC. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF TEXAS SCENIC COMPANY, INC. THE DESIGN IS CONTAINED HEREIN AND IS THE PROPERTY OF TEXAS SCENIC COMPANY, INC. SUBJECT TO THE FOREGOING.	
REV:	SCALE:	BY:	DESCRIPTION:
-	AS NOTED		
DRAWING NUMBER:		E100-31	